

**Report in Accordance with  
BS EN ISO 10077-1:2006**

**Thermal Performance of  
Windows, Doors & Shutters**

**Calculation of Thermal Transmittance  
Part 1: Simplified Method**

**CONFIDENTIAL**

Report reference: CU13018-6

Issue date: 7 June 2013

Project: W20 steel single doorset

Prepared for: Fabco Sanctuary Ltd  
Unit 1 Hobbs New Barn  
Climping  
Littlehampton  
West Sussex BN17 5RE

**Build Check Ltd**  
Montrose House  
Lancaster Road  
Cressex Business Park  
High Wycombe  
Bucks HP12 3PY

Tel: 01494 452713 Fax: 0870 210 1013  
E-mail: [info@buildcheck.co.uk](mailto:info@buildcheck.co.uk)



Notified Body: 1806

*This document is confidential and remains the property of Build Check Ltd*

*Opinions and interpretations expressed herein are outside the scope of UKAS accreditation*

*The legal validity of this report can only be claimed on presentation of the complete report.*

## 1 Introduction

This document details the thermal performance calculation of the Montan Stahl W20 steel doorset with kick plate, configuration as detailed below.

The frame profile results detailed below are provided by computer simulation using LBL software program THERM 5.2 and validated against proofs in Annex D (D1 to D10) of BS EN ISO 10077-2:2012. The frame profile results detailed below are provided from methods contained in BS EN ISO 10077-1:2006.

## 2 Summary of Results

### 2.1 Frame thermal transmittance (in accordance with BS EN ISO 10077-1: 2006)

Frame Profile	Frame Thermal Transmittance ( $U_f$ )
Threshold and bottom jambs	6.0 W/m <sup>2</sup> K
Head and top jambs	6.2 W/m <sup>2</sup> K
Mid rails	5.8 W/m <sup>2</sup> K
Bottom rail	5.6 W/m <sup>2</sup> K

### 2.2 Linear thermal transmittance (in accordance with BS EN ISO 10077-1: 2006)

Frame Profile	Linear Thermal Transmittance ( $\psi$ )
Threshold and bottom jambs	0.056 W/m.K
Head and top jambs	0.066 W/m.K
Mid rails	0.14 W/m.K
Bottom rail	0.12 W/m.K

### 2.3 Centre pane U-Value of glazing calculated in accordance with BS EN 673: 2011

Glazing unit	Centre pane U-value ( $U_g$ )
Nominal dimensions 4-10-4 90% krypton 10% air filled, normal emissivity 0.01 (4mm float, 10mm cavity, 4mm Planitherm One) with Swisspacer V spacer	0.96 W/m <sup>2</sup> K

### 2.4 U-Value


The thermal performance of the window ( $U_w$ ) in accordance with EN ISO 10077-1:2006 is:

**2.3 W/m<sup>2</sup>K**

All profile calculations based on BS EN ISO 10077-2:2012


*The legal validity of this report can only be claimed on presentation of the complete report.*

**Figure 1. Technical drawing of head and top jambs.**

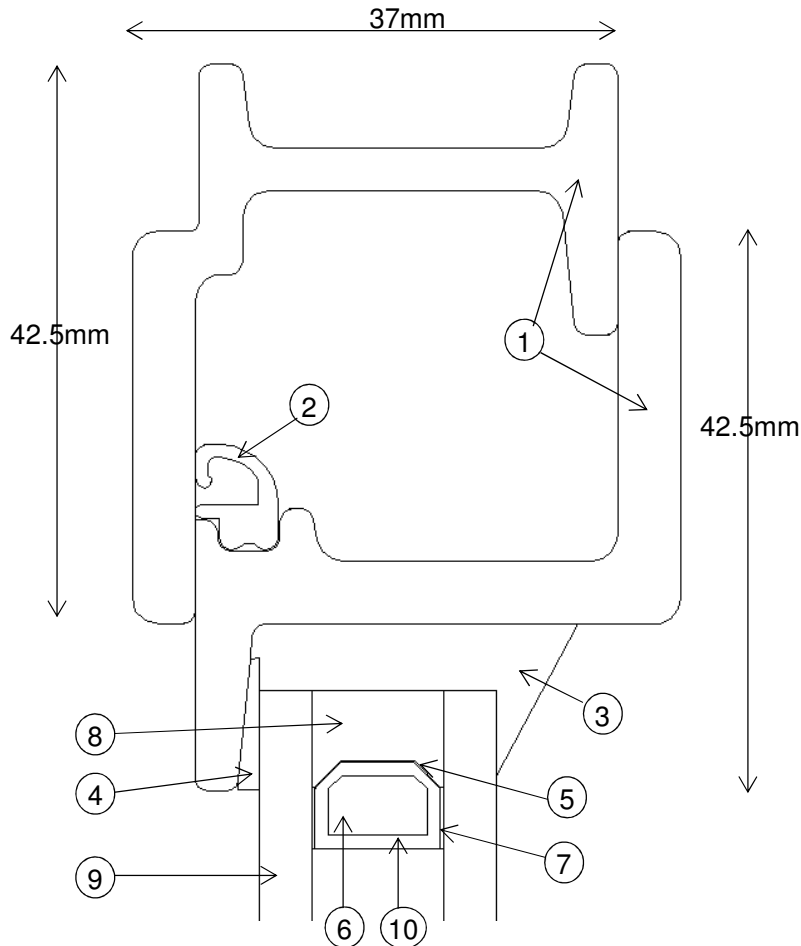


Material		Thermal Conductivity W/(m.K)
1	Steel, Annex A of BS 10077-2	50.0
2	EPDM, Annex A of BS 10077-2	0.24
3	Silicone, Annex A of BS 10077-2	0.35
4	PVC flexible, Annex A of BS 10077-2	0.14
5	Stainless steel, Annex A of BS 10077-2	1.42
6	Molecular sieve desiccant, Annex A of BS 10077-2	0.10
7	Polyisobutylene, Annex A of BS 10077-2	0.20
8	Polysulfide/polyurethane, Annex A of BS 10077-2	0.40
9	Soda lime glass, Annex A of BS 10077-2	1.0
10	Fibre-glass (UP Resin), Annex of BS 10077-2	0.4

**Figure 2. Technical drawing of threshold and bottom jambs profile.**

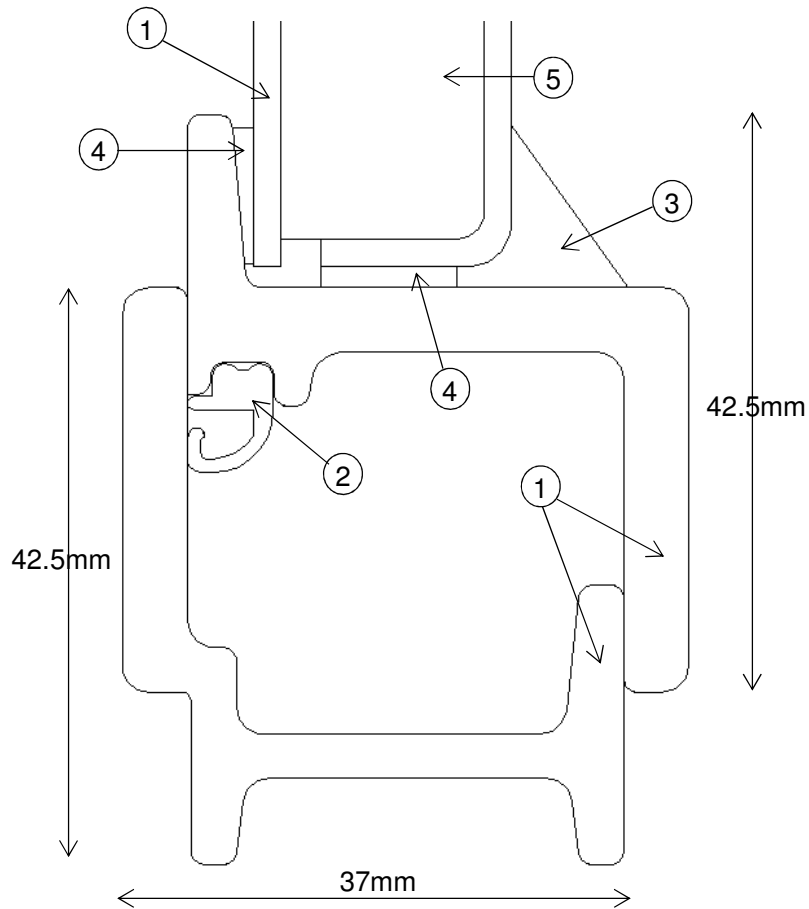


Material		Thermal Conductivity W/(m.K)
1	Steel, Annex A of BS 10077-2	50.0
2	EPDM, Annex A of BS 10077-2	0.24
3	Silicone, Annex A of BS 10077-2	0.35
4	PVC flexible, Annex A of BS 10077-2	0.14
5	Plywood (density 70kg/m <sup>3</sup> ), Annex A of BS 10077-2	0.17

**Figure 3. Technical drawing of mid rails profile.**

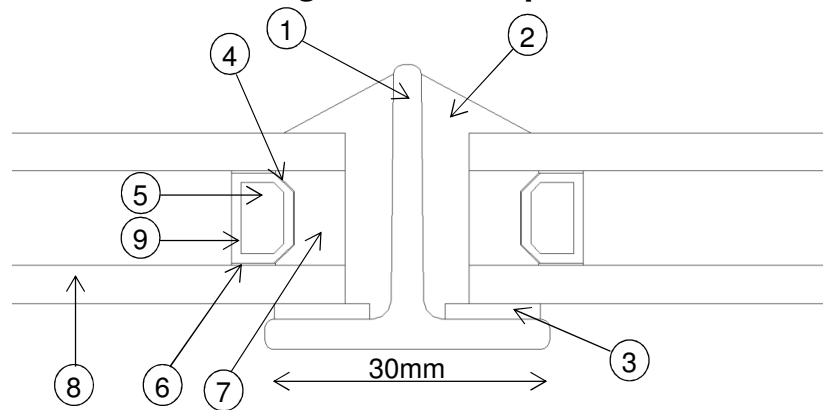


**Figure 4. Technical drawing of bottom rail profile.**

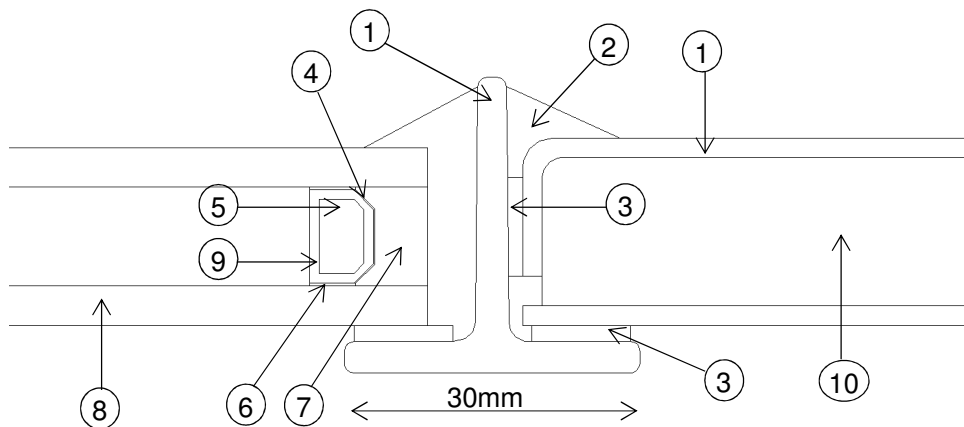

Material		Thermal Conductivity W/(m.K)
1	Steel, Annex A of BS 10077-2	50.0
2	Silicone, Annex A of BS 10077-2	0.35
3	PVC flexible, Annex A of BS 10077-2	0.14
4	Stainless steel, Annex A of BS 10077-2	1.42
5	Molecular sieve desiccant, Annex A of BS 10077-2	0.10
6	Polyisobutylene, Annex A of BS 10077-2	0.20
7	Polysulfide/polyurethane, Annex A of BS 10077-2	0.40
8	Soda lime glass, Annex A of BS 10077-2	1.0
9	Fibre-glass (UP Resin), Annex of BS 10077-2	0.4
10	Plywood (density 70kg/m <sup>3</sup> ), Annex A of BS 10077-2	0.17


*The legal validity of this report can only be claimed on presentation of the complete report.*

**Figure 5. Drawing of the window configuration and overall dimensions (from the internal face)**

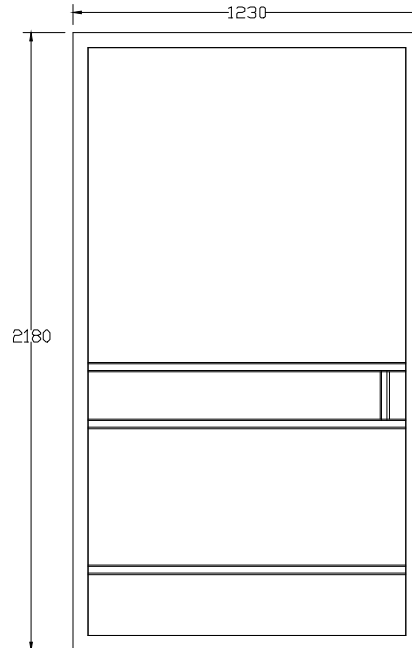

Internal projected frame area ( $A_{f,i}$ )	0.435 m <sup>2</sup>
External projected frame area ( $A_{f,e}$ )	0.435 m <sup>2</sup>
Glazed area of configuration ( $A_g$ )	1.978 m <sup>2</sup>
Frame area of configuration ( $A_f$ )	0.435 m <sup>2</sup>
Perimeter length of the glazing ( $l_g$ )	8.284 m


Figure 6. Head and top jambs profile simulation

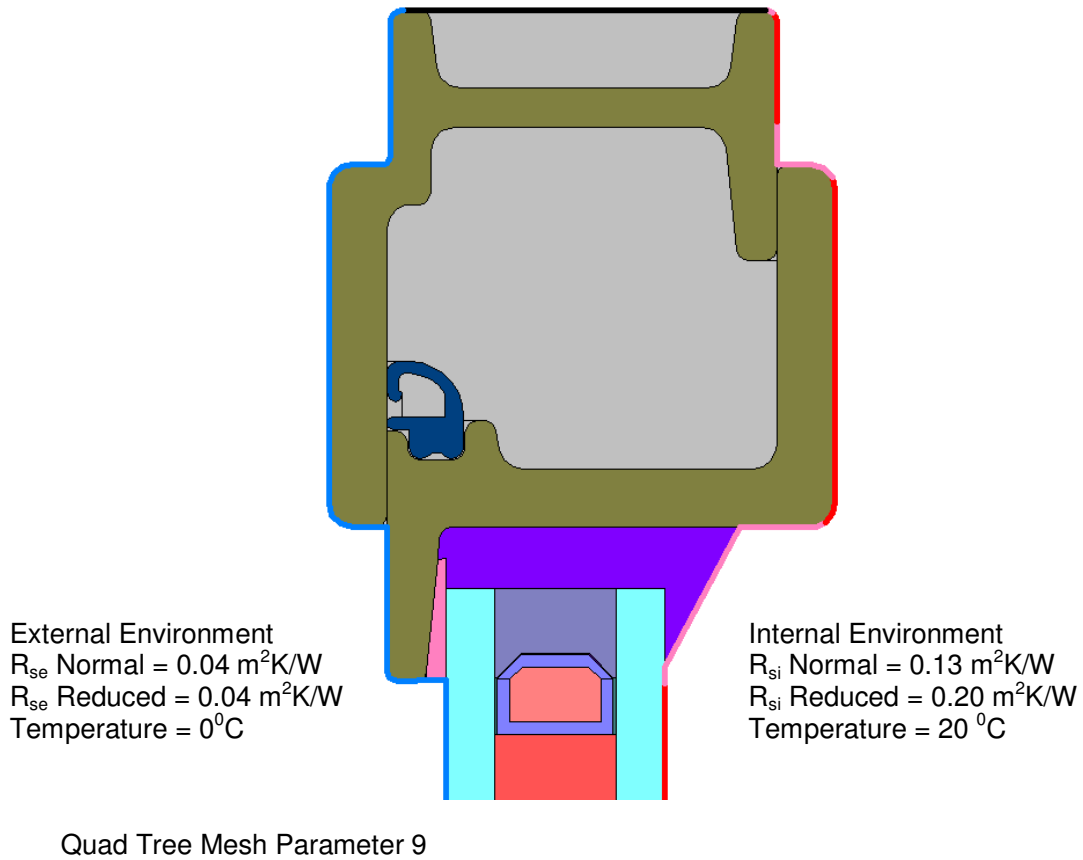

### Figure 7. Threshold and bottom jambs profile simulation

External Environment  
 $R_{se}$  Normal =  $0.04 \text{ m}^2\text{K/W}$   
 $R_{se}$  Reduced =  $0.04 \text{ m}^2\text{K/W}$   
Temperature =  $0^\circ\text{C}$


Internal Environment  
 $R_{si}$  Normal =  $0.13 \text{ m}^2\text{K/W}$   
 $R_{si}$  Reduced =  $0.20 \text{ m}^2\text{K/W}$   
Temperature =  $20^\circ\text{C}$

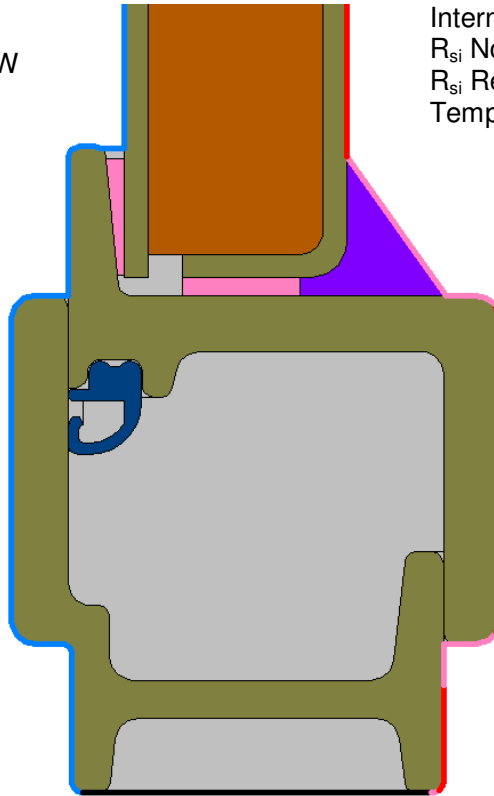


Quad Tree Mesh Parameter 9



**Figure 8. Mid rails profile simulation**

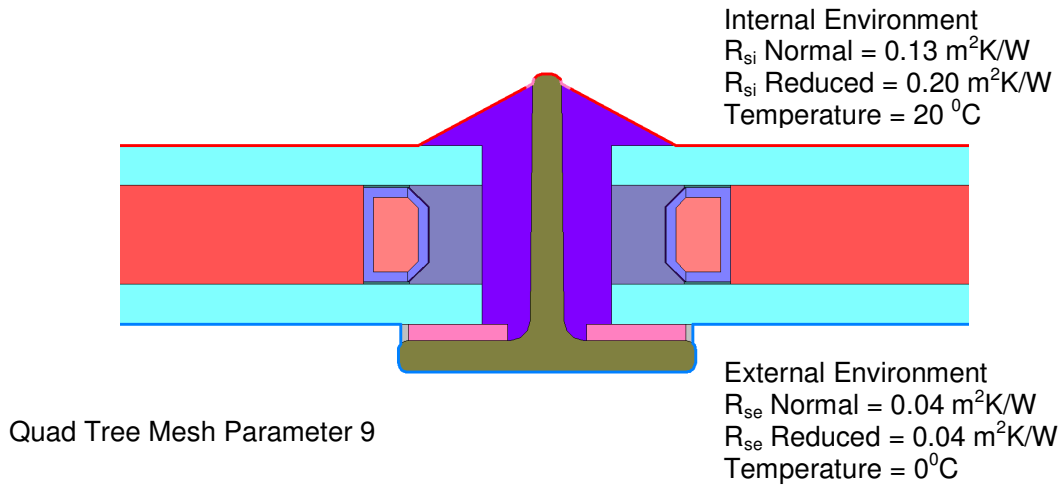

**Figure 9. Bottom rail profile simulation**

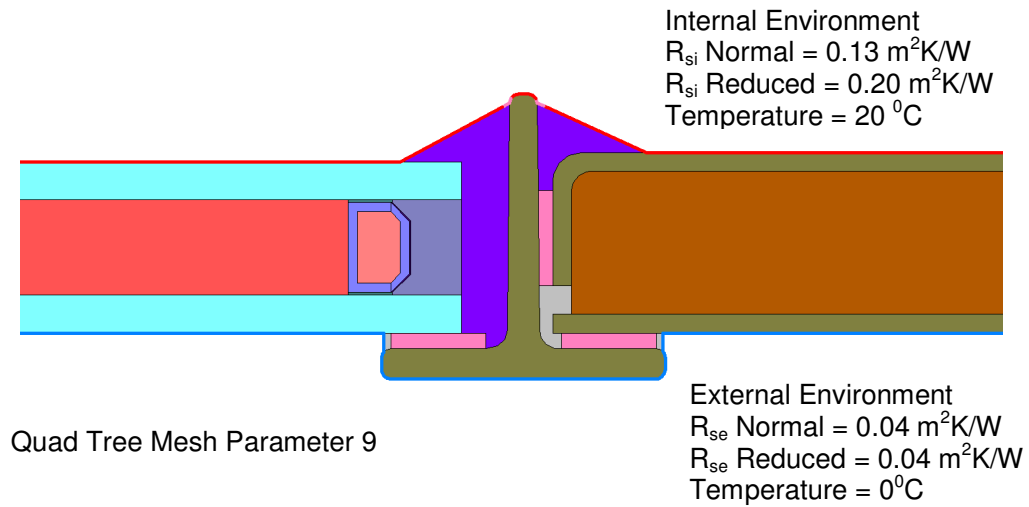

## Glazing unit 4-10-4 Low E 0.01 uncorrected 90% krypton 10% air filled

BS EN 673:2011 Glass in building- Determination of thermal transmittance (U value)-Calculation method.					
Standardised boundary conditions (section 8)					
r	1	m.K/w		Thermal resistivity of soda lime glass	
$\epsilon$ glass	0.837			Corrected emissivity of uncoated soda lime and borosilicate glass surface	
delta T	15	K		Temperature difference between bounding glass surface	
Tm	283	K		Mean temperature of gas space	
$\sigma$	5.67E-08	W/(m <sup>2</sup> K <sup>4</sup> )		Stefan-Boltzmann's constant	
he	25	W/(m <sup>2</sup> K)		External heat transfer coeff. for uncoated soda lime glass surfaces	
hi	7.7	W/(m <sup>2</sup> K)		Internal heat transfer coeff. for uncoated soda lime glass surfaces	
A	0.035			Constant	
n	0.38			Exponent	
Gas properties (section 6)					
Density: $\rho$	3.3272	kg/m <sup>3</sup>			
Dynamic viscosity: $\mu$	2.34E-05	kg/(ms)			
Thermal conductance: $\lambda$	0.010596	W/(m.K)			
Specific Heat Capacity: c	321.3	J/(kg.K)			
s	0.01	m		width of gas space	
$\epsilon$ 1	0.837			corrected emissivity of surface 1	
$\epsilon$ 2	0.013			corrected emissivity of surface 2 or 0.18	
Glass pane 1 d	0.004	m		thickness of glass 1	
Glass pane 2 d	0.004	m		thickness of glass 2	
Calculated values					
Pr	7.08E-01				
Gr	1.05E+04				
Nu	1.04E+00	1	1.04E+00	If Nu is less than 1, use Nu = 1.	
hr	6.48E-02				
hg	1.10E+00				
hs = hr + hg	1.16E+00				
1/ht	8.67E-01				
1/U = 1/he + 1/ht + 1/hi	1.04E+00				
Centre pane U value	<b>0.9644026</b>				

The legal validity of this report can only be claimed on presentation of the complete report.